

1934

Bangor Hydro Electric Company: Transition System Book 4

Bangor Hydro Electric Company

Follow this and additional works at: https://digicom.bpl.lib.me.us/bangorhydro_linework

Recommended Citation

Bangor Hydro Electric Company, "Bangor Hydro Electric Company: Transition System Book 4" (1934). *Line Work*. 2.
https://digicom.bpl.lib.me.us/bangorhydro_linework/2

This Book is brought to you for free and open access by the Bangor Hydro Electric Company at Bangor Community: Digital Commons@bpl. It has been accepted for inclusion in Line Work by an authorized administrator of Bangor Community: Digital Commons@bpl. For more information, please contact ccoombs@bpl.lib.me.us.

BOOK 4

DISTRIBUTION SYSTEM (CONT'D)

MISCELLANEOUS

J. O. 6007 Bangor Hydro-Electric Co.

INDEX TO PHOTOGRAPHS

Photo. No.
S. & W. Appraisal
J. O. 6007

Book No. 4
Vol. No.

DISTRIBUTION SYSTEM (CONT'D)

576	Hampden
570	Howland
593	Hancock
597	Jonesboro
594	Jonesport
598	Lamoine
600	Lincoln
614	Machias and Machiasport
618	Marshfield
619	Mattawamkeag
622	Medway
624	Milford
628	Millbridge
631	Millinocket
639	Mount Desert
641	Old Town
674	Orono
690	Orrington
693	Passadumkeag
695	Pembroke
696	Perry
697	Sedgwick
698	Sorrento
699	Southwest Harbor
701	Sullivan
702	State Hospital (Bangor)
703	Steuben
704	Surry
705	Tremont
707	Trenton
708	Veazie
712	Whiting
713	Whitneyville
714	Winn
717	Winter Harbor
720	Winterport

MISCELLANEOUS

722	Meter Installation, Old Town
723	Cable Crossings
726	Street Lighting Fixtures

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-29 in Howland with Street Light

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-16 in Howland with Transformer

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-80 in Howland with Transformer

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-125 in Howland with Transformer

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-164 in Howland with Span Light

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LH-166 in Howland with Transformer

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH3 in Hampden, with Three Transformers

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH593 in Hampden, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH22 in Hampden, with Trolley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



12-3 HAMPDEN BH 602

DISTRIBUTION SYSTEM

Pole BH602 in Hampden, with Two Transformers

Inspectors and Field Inventory by Waite on August 8, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole BH649 in Hampden, Jointly Owned

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007

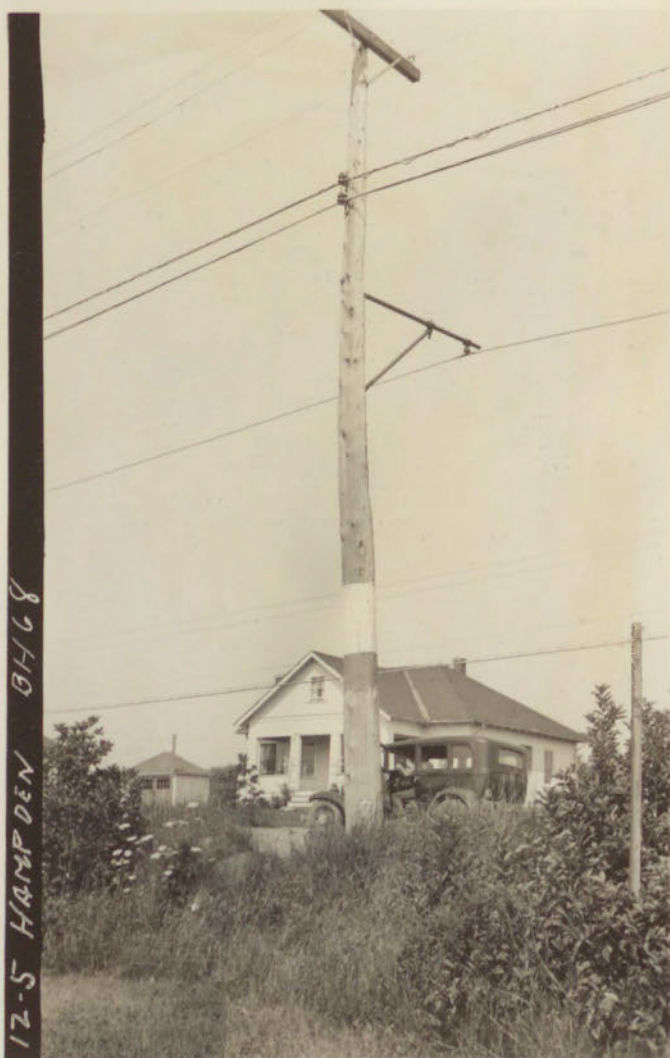

DISTRIBUTION SYSTEM

Pole BH68 in Hampden, with Trolley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH646 in Hampden, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH95 in Hampden, with Alley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BHL59 in Hampden, with Street Light

Inspection and Field Inventory by Waite on August 8, 1934

- J. O. 6007



DISTRIBUTION SYSTEM

Pole BHL63 in Hampden, with Buck Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007

12-10 HAMPDEN
NEXT TO BH163

DISTRIBUTION POLE IN HAMPDEN

Services over Telephone Wires

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH425 in Hampden, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BHL71 in Hampden, with Alley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH205 in Hampden, with Two Transformers

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH235 in Hampden, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH386 in Hampden

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BH368 in Hampden, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole EH-16 in Hancock, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J.O. 6007

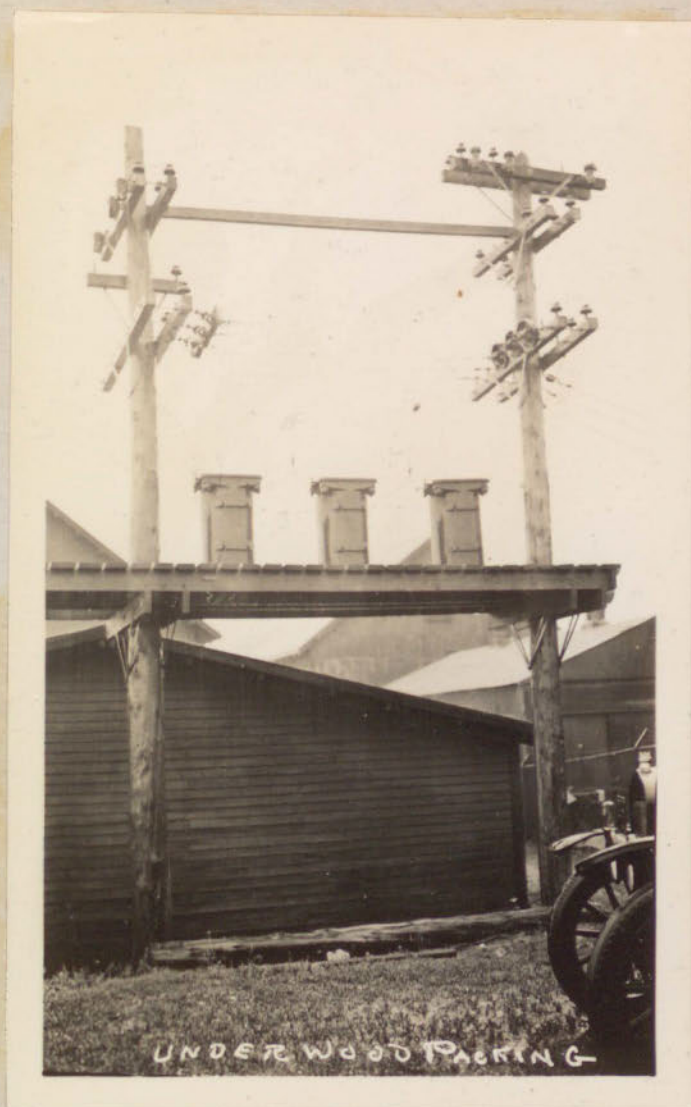

UNDERWOOD PACKING CO. SUBSTATION (Jonesport)

J. O. 6007




DISTRIBUTION SYSTEM

Pole HJ50 in Jonesport, with Transformer

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007

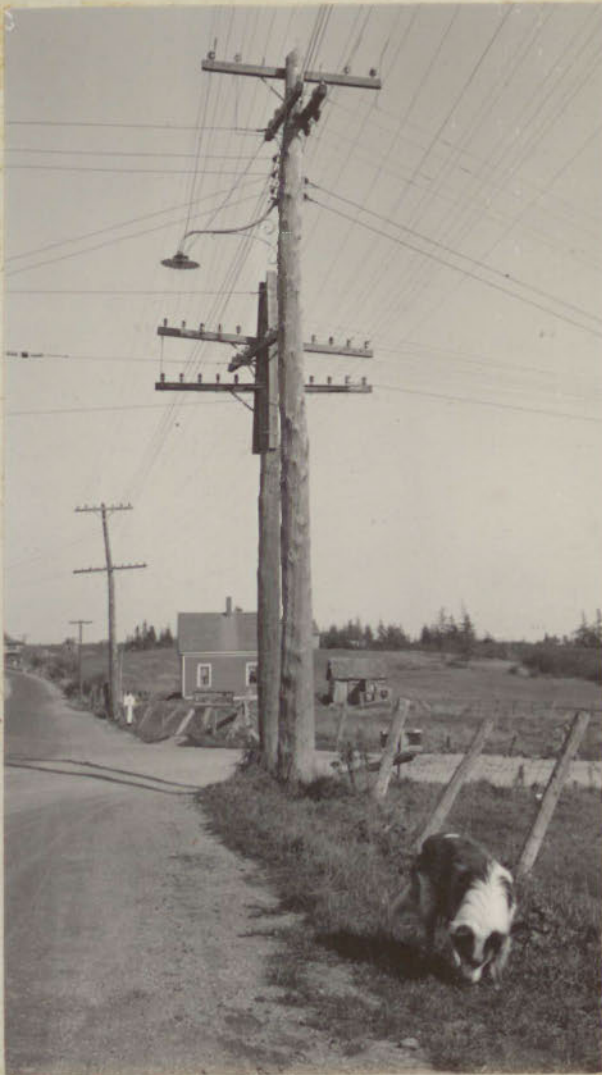

DISTRIBUTION SYSTEM

Pole HJ78 in Jonesport, with Street Light

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole WJ10 in Jonesboro, with Street Light

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007

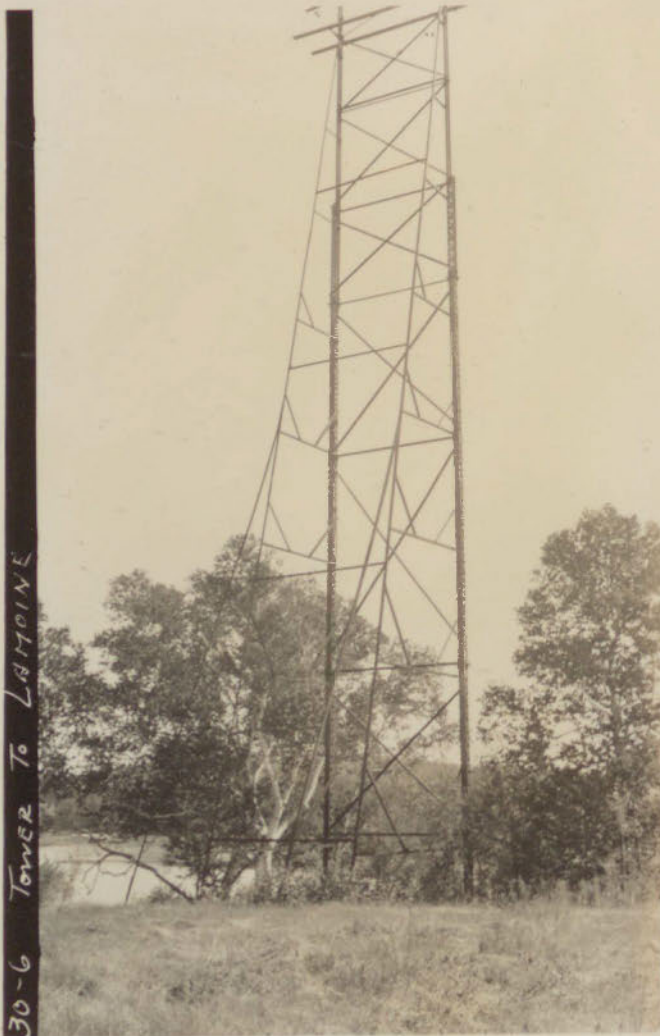

DISTRIBUTION SYSTEM

Tower at Jordan River, Trenton to Lamoine

Inspection and Field Inventory by Waite on August 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole EL-155 in Lamcine, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L400 in Lincoln with Street Light

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L397 in Lincoln, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L375 in Lincoln, Jointly Owned

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L358 in Lincoln, with Transformers

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L27 in Lincoln, with Buck Arm

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L495 in Lincoln, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L492 in Lincoln, with Underground Services

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L510 in Lincoln, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L554 in Lincoln, with Alley Arm

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L36 in Lincoln, with Transformer and Street Light

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L6 in Lincoln with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L5 in Lincoln, with Special Gooseneck

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole L90 in Lincoln, with Transformer

J. O. 6007



DISTRIBUTION SYSTEM

Pole L83 in Lincoln, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole W222 in Machias, with Street Light

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole WP53 in Machiasport, with Transformer

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole WP96 in Machiasport, with Street Light

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole W79 in Machias, with Transformers

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole WML4 in Marshfield, with Transformer

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LM70 in Mattawankeag

J. O. 6007



DISTRIBUTION SYSTEM

Pole LM55 in Mattawamkeag showing Decay

Inspection and Field Inventory on Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LM109 in Mattawamkeag with Transformers

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole MM28 in Medway with Transformer

J. O. 6007



DISTRIBUTION SYSTEM

Pole MM45 in Medway

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OM10 in Milford, Jointly Owned

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OM20 in Milford, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OM31 in Milford

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OM41 in Milford, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole HM2 in Mill Bridge, with Street Lighting Transformer

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole HM101 in Mill Bridge, with Street Lighting

Inspection and Field Inventory by Waite on October 17, 1934

J.O. 6007



MILLBRIDGE SUBSTATION

J. O. 6007



DISTRIBUTION SYSTEM

Pole M544 in Millinocket, with Secondaries

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M4 in Millinocket, with Buck Arm

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M97 in Millinocket, with Transformers

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M84 in Millinocket, with Three Transformers

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M50 in Millinocket, with St. Light

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M139 in Millinocket, with Three Transformers

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole ML51 in Millinocket, with Transformer

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole M436 in Millinocket, with Transformer

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole RD370 in Mount Desert, with Street Light

Inspection and Field Inventory by Waite on October 18, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole RD569 in Mount Desert, with Street Light

Inspection and Field Inventory by Waite on October 18, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0789 in Old Town with Street Light

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0797 in Old Town with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0117 in Old Town, Jointly Owned

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION TOWER IN OLD TOWN

River Crossing from Milford

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0806 in Old Town with Trolley Feed

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0960 in Old Town with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0366 in Old Town with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 020 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



PRIVATE POLE AT POST OFFICE IN OLD TOWN

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0391 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0561-562 in Old Town with 150 Kva. Bank

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0568 in Old Town with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 030 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Steel Pole in Old Town with Street Light and Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0780 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



20-1 OLD TOWN 0765

DISTRIBUTION SYSTEM

Pole 0765 in Old Town, Jointly Owned

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0717 in Old Town, with Fire Alarm

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0779 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0841 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0614 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0140 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0582 in Old Town

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0592 in Old Town, with Underground Service

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0280 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0288 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0290 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0299 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0692 in Old Town, with Street Light

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0443 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1984

J. O. 6007



DISTRIBUTION SYSTEM

Pole 0500 in Old Town, Jointly Owned

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 068 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 098 in Old Town

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole 087 in Old Town, with Transformer

Inspection and Field Inventory by Waite on August 10, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC440 in Orono, with Street Light

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC415 in Orono, with Alley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC558 in Orono, with Street Light

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC569 in Orono, with Trolley Arm

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC676 in Orono, with Stillwater Tie

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC724 in Orono, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC505 in Orono, with Two Transformers

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC497 in Orono, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole OC122 in Orono, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007

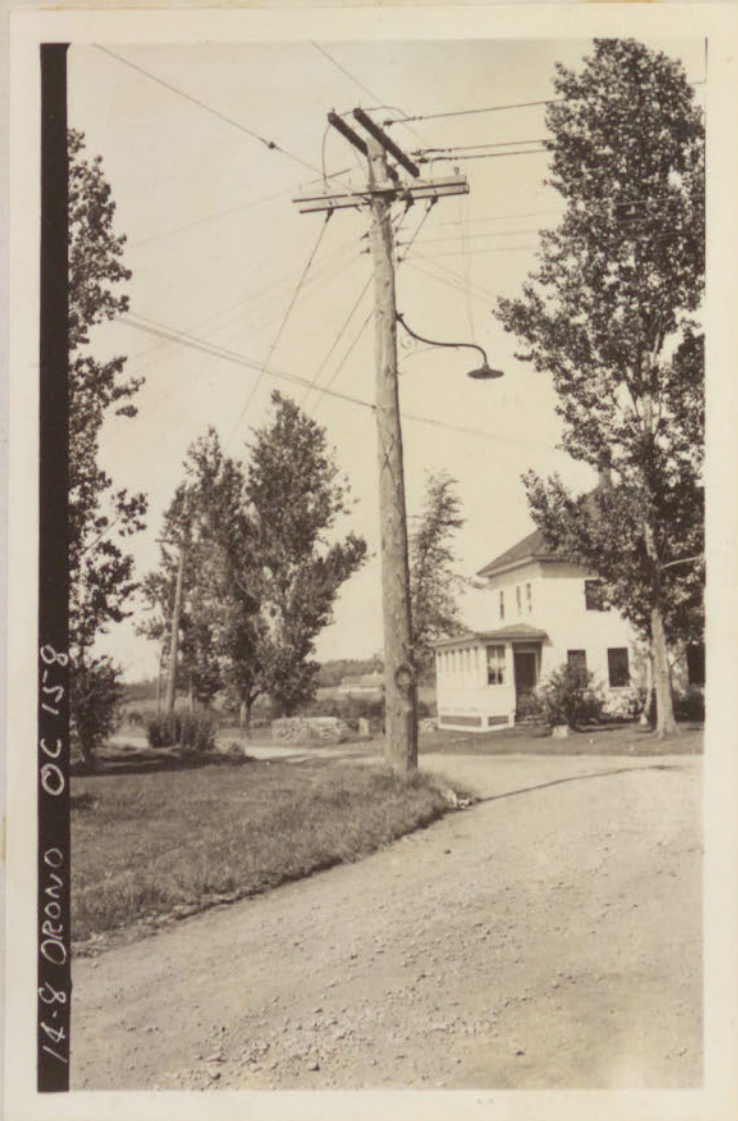

DISTRIBUTION SYSTEM

Pole OC158 in Orono, with Street Light

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC302 in Orono, with Street Light

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC314 in Orono, with Transformer

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole OC717 in Orono, with Cutouts

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007

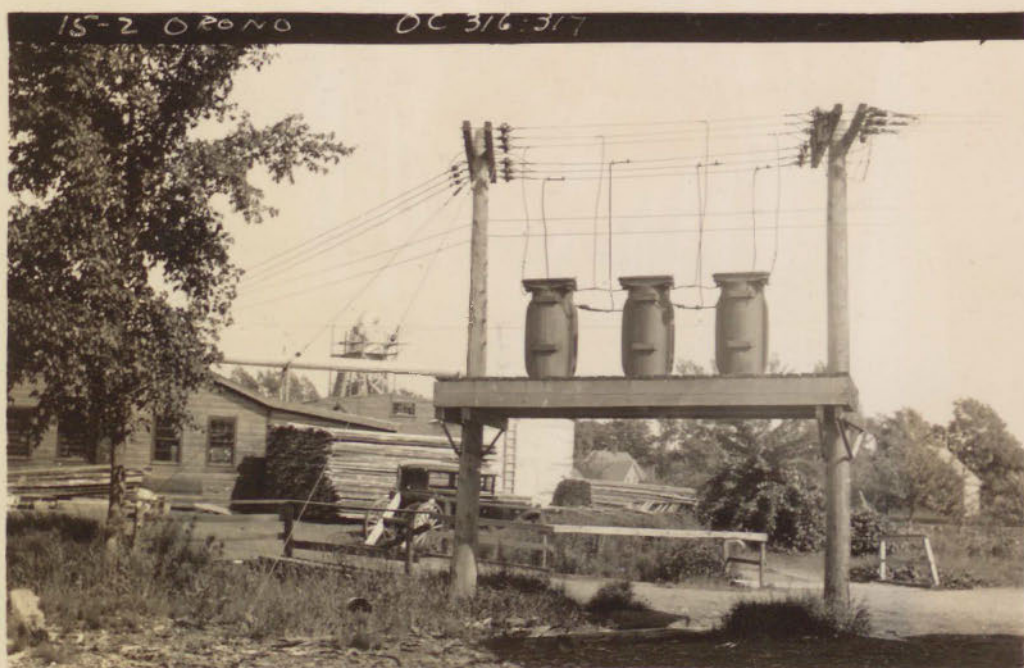

DISTRIBUTION SYSTEM

Pole OC316-317 in Orono, with Transformer Bank

Inspection and Field Inventory by Waite on August 8, 1964

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC39 in Orono, with St. Light

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole OC73 in Orono, with St. Light

Inspection and Field Inventory by Waite on August 8, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole B03 in Orrington, with Transformer

Inspection and Field Inventory by Waite on August 7, 1934

J. O. 6007

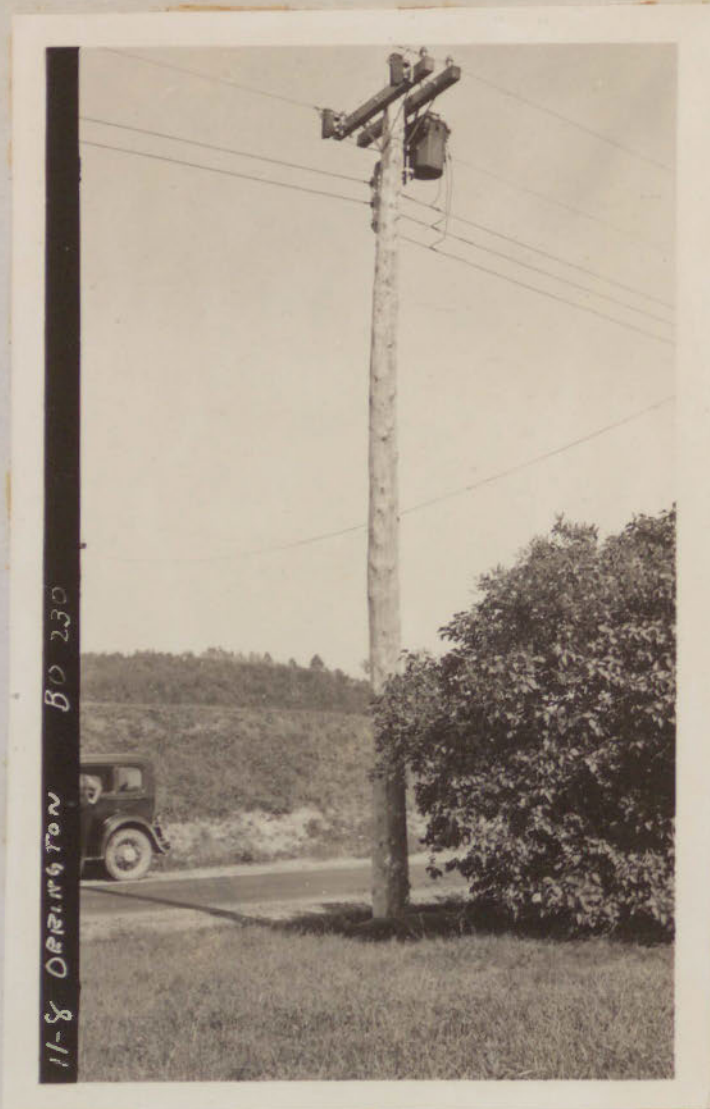

DISTRIBUTION SYSTEM

Pole B0230 in Orrington, with Transformer

Inspection and Field Inventory by Waite on August 7, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole B0270 in Orrington

Inspection and Field Inventory by Waite on August 7, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole B03 in Orrington with Transformer

Inspection and Field Inventory by Waite on July 31, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LP-7 in Passadumkeag with Street Light

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole LP-16 Passadumkeag with Transformer

Inspection and Field Inventory by Waite on August 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole DP152 in Pembroke with Transformer

Inspection and Field Inventory by Waite on October 16, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole DSX67 in Perry with Street Light

J. O. 6007



DISTRIBUTION SYSTEM

Pole EX203 in Sedgwick, with Transformer

Inspection and Field Inventory by Waite on October 19, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole EO-40 in Sorrento, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J.O. 6007

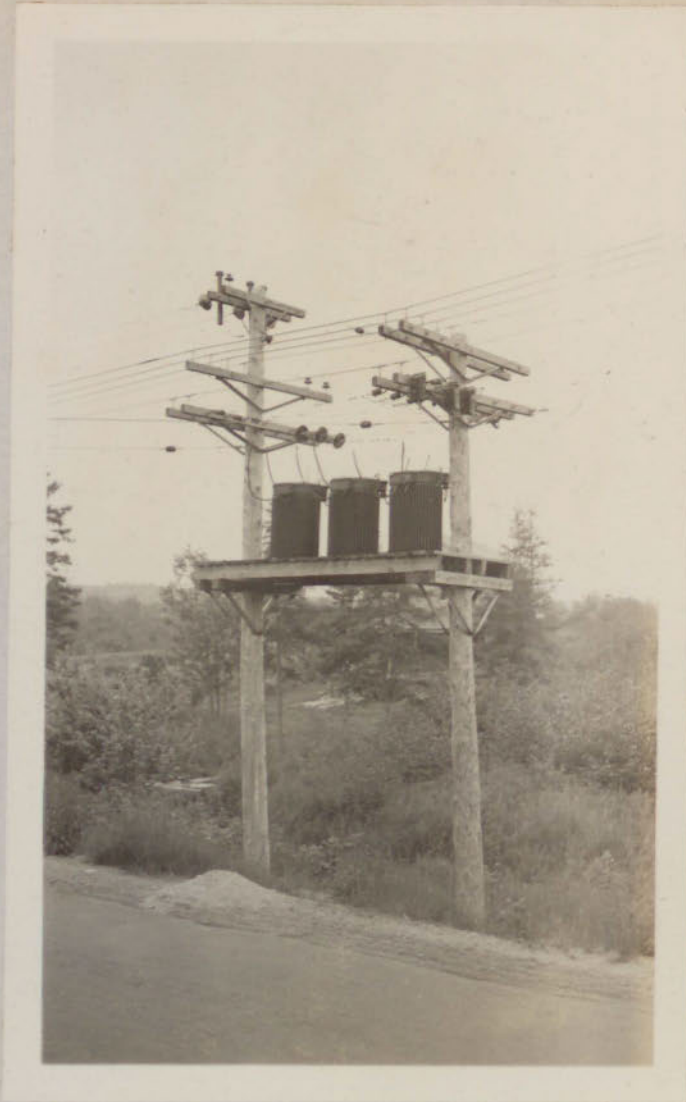

SOUTHWEST HARBOR SUBSTATION

Transformers on Pole Structure opposite Substation

Inspection and Field Inventory by Melville and Stroberg on July 20, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole RS355 in Southwest Harbor, with Ornamental Light

Inspection and Field Inventory by Waite on October 18, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole ED-51 in Sullivan, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J.O. 6007

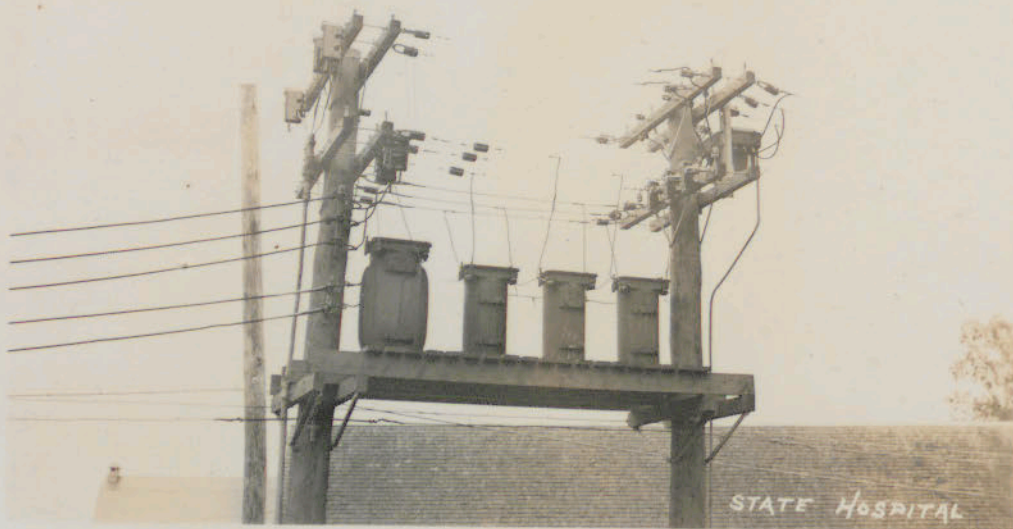

STATE HOSPITAL SUBSTATION-(Bangor)

Inspection and Field Inventory by Stroberg on July 31, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole HS88 in Steuben

J. O. 6007



DISTRIBUTION SYSTEM

Pole ES154 in Surry, with Street Light

Inspection and Field Inventory by Waite on October 19, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole RT-363 in Tremont, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J.O. 6007



TREMONT SUBSTATION

J. O. 6007



DISTRIBUTION SYSTEM

Pole ET-111 in Trenton, with Transformer

Inspection and Field Inventory by Waite on October 18, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BV61 in Veazie, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BV82 in Veazie, with Street Light

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BV87 in Veazie, with Street Light

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BV122 in Veazie, with Transformer

Inspection and Field Inventory by Waite on August 24, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole WW10 in Whiting, with Transformer

Inspection and Field Inventory by Waite on October 16, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole W322 in Whitneyville, with Street Light Transmission

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole on Lee Rd. in Winn with Street Light

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007

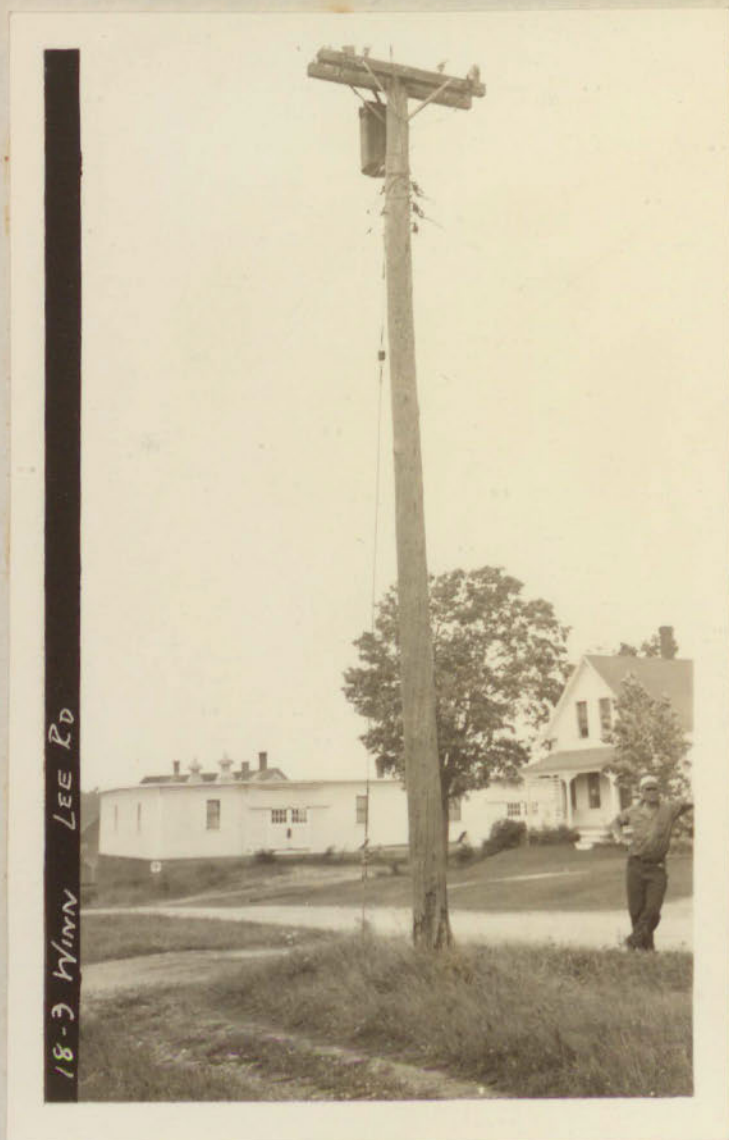

DISTRIBUTION SYSTEM

Pole on Lee Rd. in Winn with Transformer

Inspection and Field Inventory by Waite on August 9, 1934

J. O. 6007




DISTRIBUTION SYSTEM

Pole LW33 in Winn with Transformer

Inspection and Field Inventory by Waite on August 9, 1934

J.O. 6007

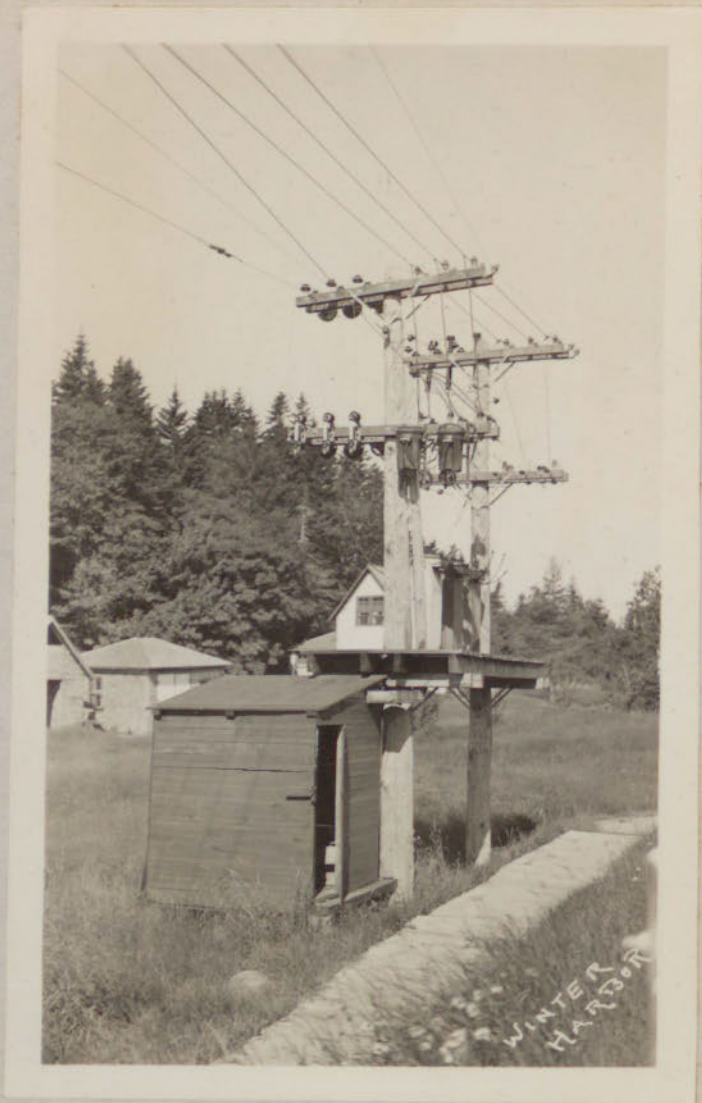

WINTER HARBOR SUBSTATION

J.O. 6007



WINTER HARBOR SUBSTATION

Transformers on Pole Structure adjacent to Substation

Inspection and Field Inventory by Melville and Stroberg on July 23, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole EW34 in Winter Harbor, with Transformer

Inspection and Field Inventory by Waite on October 17, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BW67 in Winterport, with Cutouts

Inspection and Field Inventory by Waite on August 6, 1934

J. O. 6007



DISTRIBUTION SYSTEM

Pole BW23 in Winterport

Inspection and Field Inventory by Waite on August 6, 1934

J. O. 6007



19-1 OLDTOWN OUTDOOR METERS

METER INSTALLATION IN OLD TOWN

Inspection and Field Inventory by Waite on August 10, 1934


J.O. 6007



BEALS ISLAND SUBMARINE CABLE CROSSING

Jonesport Terminal


J.O. 6007

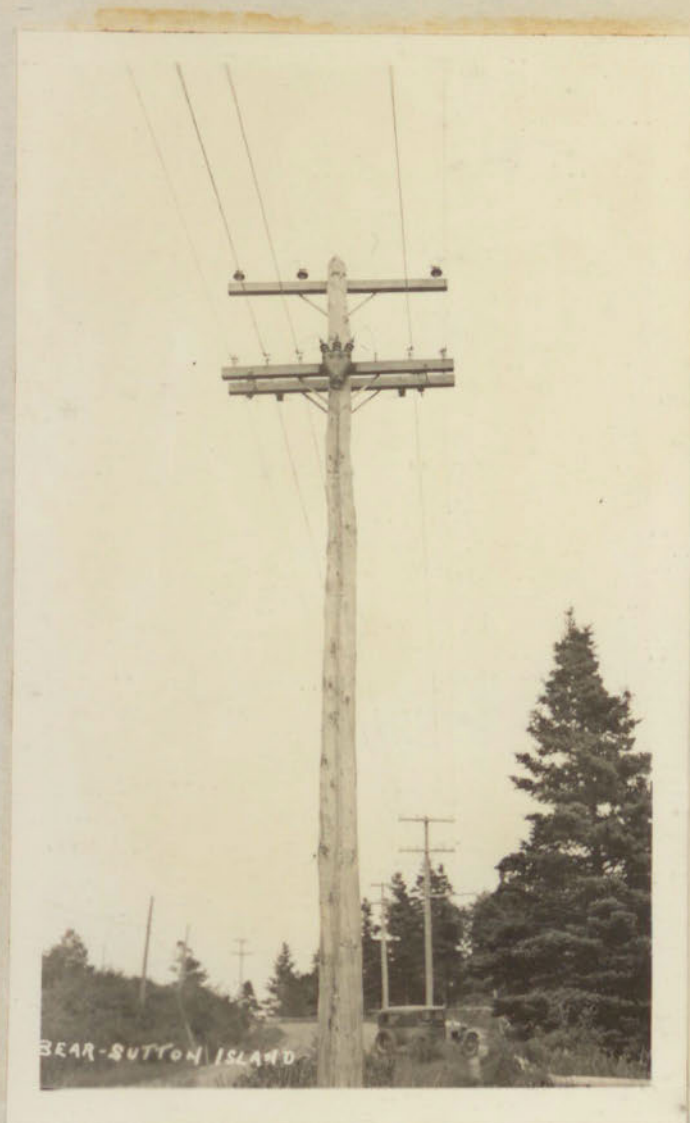

BEAR & SUTTON ISLAND SUBMARINE CABLE CROSSING

Seal Harbor Terminal

J.O. 6007

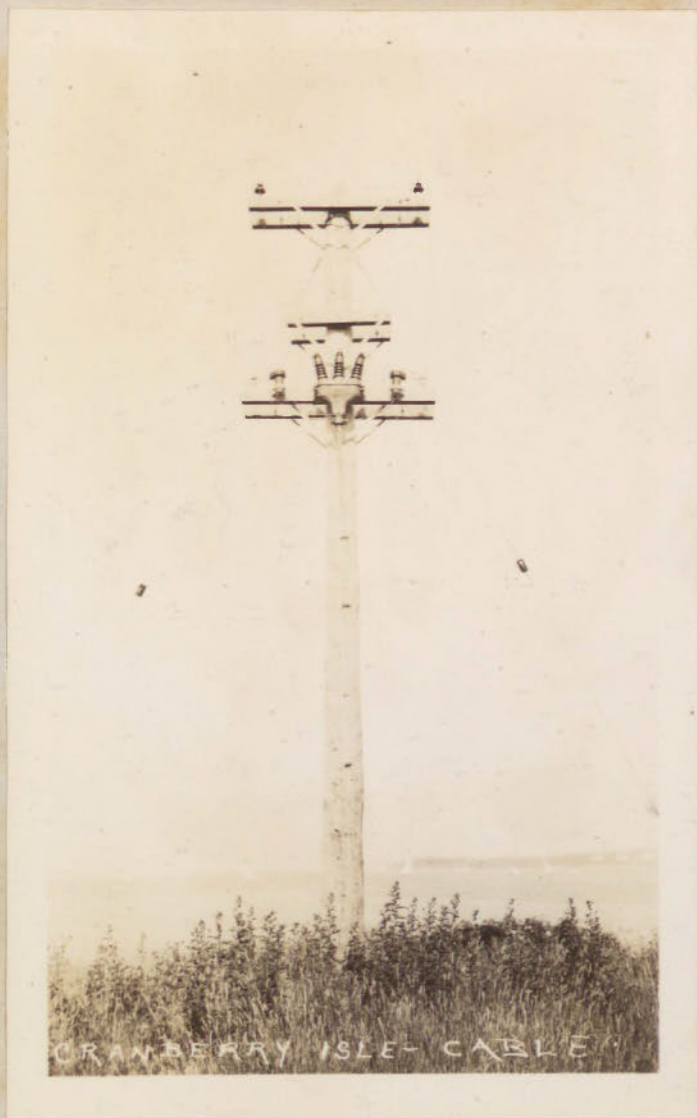

CRANBERRY ISLE SUBMARINE CABLE

Southwest Harbor Terminal

J. O. 6007



STREET LIGHTING FIXTURE, GOOSENECK

Line Material Cat. No. A18

Brewer, Pole #A771

J. O. 6007



STREET LIGHTING FIXTURE GOOSENECK

Similar to G. E. 114,768

Old Town-Milford, Pole #OM4

J. O. 6007



STREET LIGHTING FIXTURE, STANDARD BRACKET

Similar to G. E. 103,156

Old Town, Pole #O-810

J. O. 6007



STREET LIGHTING FIXTURE, ORNAMENTAL BRACKET

Similar to Westinghouse 252,264

Brewer, Pole #181

J. O. 6007



STREET LIGHTING FIXTURE, ORNAMENTAL BRACKET

Similar to Westinghouse 252,264

Brewer, Pole #A173

J. O. 6007



STREET LIGHTING FIXTURE, ORNAMENTAL STANDARD

Bar Harbor, Adjacent to Pole R200

Inspection and Field Inventory by Seaburg on October 29, 1934